


## 1600J L1 See-Thru Linear DV ZC Framing

October 2017 1/2

#### **Framing Dimensions**

NOTE: Height of cavity may be affected by vent configuration with clearance

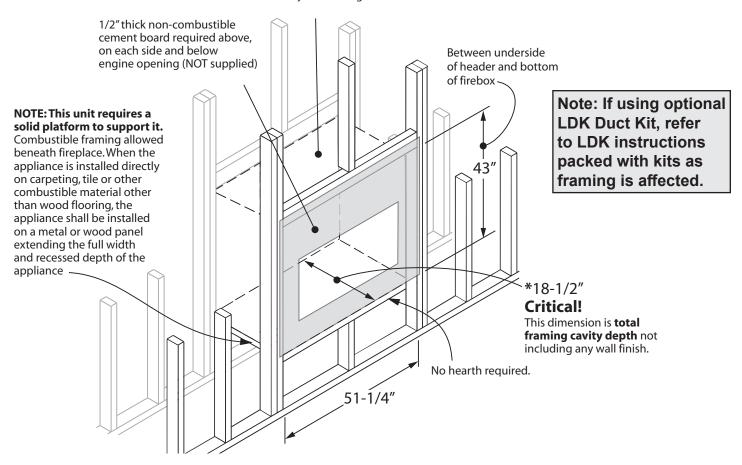




# 1600J L1 See-Thru Linear DV ZC Framing

October 2017 2/2

#### Venting Considerations—Vertical Takeoff

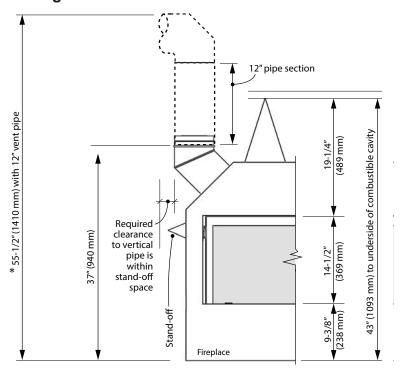

### \*Notes—ALL venting considerations

- Dimensions of venting are based on using Dura-Vent elbows. Elbow curve radius dimensions will vary when using other brands. In general, other brands have slightly bigger radius.
- Minimum 12 inches vertical pipe section required right at unit. Refer to venting chart for allowable horizontal runs.
- 3 inches to combustibles required above horizontal pipe. Slope pipe upwards 1/4 inch per foot. 1 inch clearance required around sides and bottom of horizontal pipe and around vertical pipe.
- When calculating effective pipe lengths subtract approximately 1-1/2 inch for pipe joint - for example, a 12 inches pipe section will add approximately 10-1/2 inches overall.

## **Venting Considerations—Horizontal Takeoff**

